



ACCENT HOUSING - FIRE RISK ASSESSMENT



Region :	North East
Scheme Name :	2 - 5 Elizabeth Terrace
Scheme Address :	Elizabeth Terrace Middlesbrough TS3 6EN
Date of Assessment:	23/04/2026
Date of Next Assessment:	23/04/2027
FRA Frequency:	Annual Re-Assessment under the Regulatory Reform (Fire Safety) Order 2005
Fire & Safety Assessor	Kevin Jones GIFireE

This Fire Risk Assessment has been conducted upon the instruction of Accent Housing.

S+A1:B43cheme Details		2 - 5 Elizabeth Terrace
Region:		North East
Scheme Name:		2 - 5 Elizabeth Terrace
Site Address:	Street:	Elizabeth Terrace
	Town:	Middlesbrough
	Post Code:	TS3 6EN
Block & Asset No.		9591
Scheme Tel. No:		N/A
Date of this Assessment		23/04/2026
Date of Next Review		23/04/2027
Fire Risk Assessment Frequency		Annual
Purpose of Fire Risk Assessment		Annual Re-Assessment under the Regulatory Reform (Fire Safety) Order 2005
Fire & Safety Assessor		Kevin Jones GFireE
Director of Customer Experience		Debbie Hinbest
Housing Partner Manager		Terri Fisher
Contract Manager		Joanne Morris
Scheme Manager/Customer Partner		Aimee Bircham
Other staff in attendance		None
Use of Building		General Needs living Sleeping accommodation
Approximate Number of occupants		Approximately 4 without conducting an intuitive poll.
Occupancy Profile		Mixed
Familiarity of the occupants		Fully Familiar
Likely state of the Occupants		Sleeping Familiar
PEEPs in place where necessary		N/A
Number of on-site Accent staff		None
Number of other (non-Accent) staff		Contract cleaners in common areas/occasional contractors
Support Agency (Supported Housing)		N/A
Current Evacuation Strategy.		Stay Put (Stay Safe) Evacuation
Evidence that residents have been notified of the evacuation procedure		Fire Evacuation notices displayed in common areas and in place
History of fires in the building		None
Scope of Assessment		Type 1 (Common Parts Only - Non Destructive)
Applicable Fire Safety Guidance		Purpose-built flats guide

Building Details	2 - 5 Elizabeth Terrace
Construction Date	Approximately 1986
Construction Type	Joisted or Load Bearing Masonry (Traditional)
Roof Finish	Pitched-Concrete Tile
External Wall Finish	Brick
Are there any areas of external wall cladding	None
Are there any balconies	None
Conversion or purpose-built	Purpose Built
Number of flats (self-contained)/rooms (HMOS, shared houses)	4
Number of storeys above ground	2
Number of storeys below ground	0
Is there a habitable basement?	No
Number of internal Staircases per Block (protected or unprotected?)	One-Protected
Number of External Staircases per Block	None
External Balcony part of escape route?	N/A
Unusual features	None
Building complexity	Simple
Building Access Conditions for Fire Brigade	Vehicular Access to one or more elevations
Surroundings: Residential/Commercial	Mixed
Fire Provision Currently in Place	
Fire Detection and Warning System	Flats and common areas not linked
Grade of fire alarm (Flats)	Grade D
Category of fire alarm (Flats)	LD3 Minimum Protection
Grade of fire alarm (Communal)	Grade D
Category of fire alarm (Communal)	LD2 Additional Protection
Additional Comments:	
Evacuation Alert System (EAS)	Not Fitted
Additional Comments:	
Emergency Lighting Provision	Non maintained common areas
Additional Comments:	
Portable Fire Extinguishers	None fitted
Fixed Fire Fighting Installations	None fitted
Additional Comments:	

Significant Findings						
2 - 5 Elizabeth Terrace				23/04/2026		
Action Ref:	Potential Area of Fire Risk	Yes-No-N/A	Observation/Comments/ Actions Required	Risk Rating	Target Completion Date	Referred To:
Fire Hazards						
1	Electrical Sources of Ignition:					
1.1	Electrical Installation within common areas (Fixed Wiring, sockets, switches, light fittings) in good condition and no obvious damage	Yes	All common area sockets and fittings in a satisfactory condition at the time of inspection	.		
1.2	Valid Electrical Installation Condition Reports held on file.(Common Areas)	Yes	Valid communal area EIC Reports uploaded to property file all In date at time of inspection Last Inspection 12/03/2026 Satisfactory	.		
1.3	Valid Electrical Installation Condition Reports held on file. (General Needs Flats)	Yes	Valid General Needs flats EIC Reports uploaded to M-Files. In date at time of inspection Satisfactory	.		
1.4	Electrical App/PA Testing - all portable appliances tested within past 12 months	N/A	No Portable appliances provided in communal areas	.		
1.5	Absence of trailing leads and adapters	N/A	see 1.4	.		
1.6	Mobility Scooters - Stored/charged in common areas, purpose built store/resident flat	N/A	No evidence or reports that any of the residents own a mobility scooter	.		
2	Smoking:					
2.1	Are there any risks associated with smoking in the building?	No	Smoking is not allowed within the communal areas. Smoking is only permitted within flats. There are no smoking signs present within the communal areas.	.		
3	Arson:					
3.1	Adequate security against arson?	Yes	Call button main entrance and secured exit door throughout property	.		
3.2	Is there an absence of unnecessary fire load in close proximity to building?	Yes	Good housekeeping observed during inspection designated bin store.	.		

4	Heating Installations (Portable/fixed) Gas Installations - Common Areas & General Needs Residential flats.				
4.1	If portable heaters are used, are there suitable controls?	N/A	There are no portable heaters within the communal area.	.	
4.2	Are fixed heating installations subject to regular maintenance?	N/A	No gas heating supply to communal areas	.	
4.3	Valid LGSC held on file for each residential flat that contains gas appliances.	N/A	There is no gas supply to individual flats.	.	
5	Cooking:				
5.1	Are reasonable measures taken to prevent fires as a result of cooking?	N/A	Cooking only permitted within flats, no communal kitchen provided	.	
5.2	Where there is extraction ventilation in communal kitchens are filters changed/cleaned and ductwork cleaned regularly?	N/A	See 15.1	.	
6	Lightning Protection System:				
6.1	Does the building have a lightning protection system. If so, is it adequately maintained?	N/A	No lightning conductor system fitted not required	.	
7	Housekeeping:				
7.1	Is the standard of housekeeping adequate?	Yes	General housing appears satisfactory at time of inspection		
7.2	Are all electrical/intake/service cupboards secure and free from general waste, contractors waste and residents personal items.	Yes	Cupboards are closed at all times and are free from any items stored.		
7.3	Are combustible materials separated from ignition sources and stored appropriately?	Yes	No unauthorised items stored were identified during inspection	.	
7.4	Are unnecessary accumulations of combustible materials or waste avoided?	Yes	see 7.3	.	
7.5	Are hazardous materials stored appropriately (i.e. oxygen cylinders, flammable materials, explosive products, oxidising products, aerosols)	N/A	No evidence of hazardous materials stored on site	.	
8	Furniture/furnishings on escape routes and other communal areas:				
8.1	Furniture/furnishings in good condition, fire retardant and complies with 1988 Regulations.	N/A	No furniture provided in communal areas	.	

9	Other Significant Fire Hazards:					
9.1	Are there other significant fire hazards that are inadequately controlled?	No	No further risks identified during inspection	.		
Fire Protection Measures						
10	Means of Escape from Fire:					
10.1	Is it considered that the building is provided with reasonable means of escape in case of fire?	Yes	Sufficient number and location of escape routes.	.		
10.2	Escape routes unobstructed and safe to use?	Yes	There were no obstructions on the means of escape at the time of inspection.	.		
10.3	Exits easily and immediately openable where necessary, without a key?	Yes	All final exit doors are fitted with thumb turn	.		
10.4	Reasonable distances of travel where there is a single/alternative direction of travel?	Yes	Minimal travel distance observed during inspection.	.		
10.5	Escape routes lead to final exits and open in direction of escape where necessary?	Yes	Clearly defined escape route directions all with signage and clear	.		
10.6	Do failsafe's on locked exit doors function correctly?	N/A	None fitted within scheme	.		
10.7	Is it considered that the building is provided with reasonable arrangements for means of escape for disabled people?	Yes	Ground floor has ramped entrance minimal threshold height,	.		
11	Measures to Limit Fire Spread and Development:					
11.1	Is it considered that the compartmentation is of a reasonable standard?	Yes	Compartmentation appears to be adequate throughout premiss.			
11.2	Is there reasonable limitation of surface finishes that might promote fire spread (walls, floors, ceilings)?	Yes	Surfaces are designed to minimise lateral / vertical fire spread - no wall coverings	.		
11.3	Are fire dampers/shutters provided in ducts/refuse chutes to protect means of escape against fire, smoke and combustion products?	N/A	None fitted within this scheme	.		
11.4	Compartmentation within roof spaces of a satisfactory standard?	Yes	Compartmentation appears satisfactory.	.		
11.5	Loft hatches fire resisting?	Yes	All fitted with adequate fire protection	.		

11.6	Fire stopping above cross-corridor fire doors within suspended ceiling void of a satisfactory standard	N/A	No Cross corridor doors in premiss			
11.7	Smoke Control Systems (AOV's) Are records of annual testing available?	N/A	No Automatic vents fitted at this scheme	.		
11.8	Roller shutter doors (fire resisting)	N/A	None fitted	.		
11.9	Do the external walls, windows, balconies etc pose a risk of significant fire spread?	No	Traditional construction brick and mortar.	.		
12	Communal Area Fire Doors (Inspection to include - construction, hinges, closure devices, intumescent/smoke seal condition, glazing systems and maximum gaps between door and frame.					
12.1	Communal fire doors to FD30s standard and in a serviceable condition,	Yes	All communal doors have been inspected and appear satisfactory at time of inspection			
12.2	"Fire door keep shut/locked" signage displayed on both sides of all applicable doors.	Yes	Signage visible during inspection	.		
12.3	Hold open devices operate at the sounding of the alarm and are in a serviceable condition	N/A	No hold open devices required in premise	.		
13	Flat entrance doors (Internal Common Areas)					
13.1	Flat entrance fire doors to FD30s standard and in a serviceable condition,	Yes	All appear to be in serviceable condition	.		
14	Flats with a single direction of escape to a single escape stairway. (External Balcony)					
14.1	Do the flat entrance doors that open onto an external balcony have to be passed during an escape?	N/A	No external balcony at scheme	.		
14.2	Are the separating walls between the flats and the balcony floor that have to be passed during an escape, fire-resisting up to a height of 1.1m?	N/A	see 14.1	.		
15	Emergency Escape Lighting:					
15.1	Is the emergency lighting correctly specified and installed as per BS 5266-1:2016	Yes	Appears to be installed to correct standard	.		
15.2	Are all emergency lighting units in good condition and securely fixed to walls/ceilings	Yes	All in good condition and secure at the time of inspection.	.		

15.9	Are records of monthly testing available?	Yes	Monthly test certs uploaded to M-Files and Active H In date at time of inspection. Last test date : - 13/04/2026	'		
15.10	Are records of annual testing available?	Yes	Annual test certs uploaded to M-Files and ActiveH In date at time of inspection. Last test date : - 02/09/2025	'		
16	Fire Safety Signs and Notices:					
16.1	Are the correct Fire Action/Advice notices displayed in prominent locations within the common areas?	Yes	The correct Notices are displayed throughout the scheme.	'		
16.3	Directional fire escape signage in place and adequate?	Yes	Positioned correctly throughout	'		
16.4	Is there a suitable LIFT sign i.e. do not use in case of fire.	N/A	No lift in premise	'		
17	Means of giving Warning in case of Fire:					
17.1	Is the fire detection and warning system appropriate for the occupancy and fire risk?	No	Government Guidance within document Fire Safety in Purpose-Built Blocks of Flats - 20.4 "In 'general needs' blocks designed to support a 'stay put' policy, it is unnecessary and undesirable for a fire alarm system to be provided. A communal fire detection and alarm system will inevitably lead to a proliferation of false alarms".The current fire detection arrangement is a limited hybrid system incorporating elements of both LD3 and LD2 coverage.This level of protection is not considered sufficient for the risk profile of the building, particularly where occupants may be more vulnerable, such as elderly residents. In such cases, earlier detection is critical to allow sufficient time for safe escape.	'		

17.2	Is the fire detection and warning system correctly specified and installed as per BS 5839-6:2017	No	It is recommended that the existing communal fire detection system be removed and that each flat is upgraded to a Grade D, LD2 fire detection system in accordance with BS 5839-6. At present, detection is primarily provided within escape routes, consistent with LD3 principles, with limited additional coverage. While LD3 systems provide a basic level of life protection by alerting occupants once smoke has entered circulation spaces such as hallways and landings, this approach may result in delayed warning. Upgrading to a Grade D, LD2 system will ensure that automatic fire detection is provided not only in escape routes but also within higher-risk rooms such as living rooms and kitchens, where fires are most likely to originate. This will provide earlier warning at the point of fire development, significantly improving life safety. Upgrading to an LD2 system introduces detection in high-risk rooms (e.g. kitchens, living rooms, boiler rooms), significantly improving early fire detection before escape routes become compromised. The removal of the communal detection system is also considered appropriate where a stay-put strategy is in place and effective compartmentation is provided, as communal detection may lead to unnecessary evacuation and is not typically required in purpose-built blocks of flats designed on this basis. This recommendation aligns with the risk-based approach required under the Regulatory Reform (Fire Safety) Order 2005 and reflects current best practice for residential fire safety.	Med	23/4/27	Project Manager Fire
17.3	Is the fire detection and warning system maintained/tested and all certificates saved on file. (BS 5839-6:2017)	Yes	Tested periodically Results are uploaded to activeH Customers are encouraged to test flat detectors.	.		
17.4	Are there heat detectors located in the Kitchen, Boiler, Plant Room and Laundry?	N/A	No Boiler room, Kitchen or switch room in premise	.		

17.5	Is the fire alarm panel remotely monitored, and if so are there records of regular testing?	N/A	Fire alarm is not monitored	.		
17.6	Are smoke/heat detectors within General Needs flats subject to an annual inspection and the results recorded on an in date Landlord Gas Safety Record (LGSR)	N/A	No gas supply to scheme flats.	.		
18	Fire Extinguishing Equipment:					
18.1	Portable fire extinguishers - appropriate type/number/position?	N/A	No portable extinguishers provided in scheme	.		
18.2	Correct signage displayed by each fire extinguisher?	N/A	See 18.1	.		
18.3	Fire blanket in communal kitchen, secured to the wall, complete with signage?	N/A	See 18.1	.		
18.4	Hose Reels - fitted, maintained?	N/A	See 18.1	.		
18.5	Dry/wet risers - Full access to all inlet/outlet boxes. All inlet/outlets secured and/or securing straps fitted to outlet valves?	N/A	See 18.1	.		
18.6	Records available of fire fighting equipment servicing within past 12 months	N/A	See 18.1	.		
19	Management of Fire Safety					
19.1	Are there suitable arrangements for summoning the fire service?	Yes	Residents responsible for calling fire service.	.		
19.2	Do relevant staff carry out regular fire safety checks	Yes	Housing Partners complete scheme inspections.	.		
19.3	Sheltered Schemes & Regional Offices - Are there sufficient number of qualified Fire wardens.	N/A	No office provided in premise	.		
19.4	Offices - Are there suitable arrangements for ensuring the premises are evacuated?	N/A	See 19.3	.		
19.5	Offices - Are there suitable arrangements for evacuating disabled people?	N/A	See 19.3	.		
19.6	Offices - Are there suitable arrangements for meeting the fire service on arrival and providing relevant information?	Yes	Customers are responsible for meeting fire service	.		

19.7	Offices/IL Schemes - Is there a suitable assembly point?	N/A	See 19.3	.		
19.8	Offices - Are fire drills carried out at appropriate intervals?	N/A	See 19.3	.		
20	Evacuation Policy					
20.1	Taking the findings of the FRA into account, is the evacuation policy appropriate for the scheme?	Yes	The evacuation policy is correct for the purpose of building. The flats were purpose built.	.		
21	Miscellaneous					
21.1	Taking the findings of the FRA into account is the frequency of FRA correct?	No	Following the identification of the need to remove communal fire detection and the upgrading of the flats fire detection I recommend the frequency and FRA be reviewed once works are completed.	Med	23/6/27	Fire Safety Manager

Residents Front Doors						
2 - 5 Elizabeth Terrace					23/04/2026	
Flat entrance doors to FD30s specification (Inspection to include - Door condition, construction, closure devices, intumescent/smoke seal condition, glazing systems, fire rated letterplate, door furniture and maximum gaps between door and frame/threshold.						
Flat No.	Access Gained	Asset No.	Observation/Comments / Actions Required	Risk Rating	Completion Date	Referred To:
				-		

Photographs - Fire

23/04/2026

2 - 5 Elizabeth Terrace



Photo No. 1

Electrical intake cupboard



Photo No. 2

Signage displayed in premises

Photographs - Fire

23/04/2026

2 - 5 Elizabeth Terrace

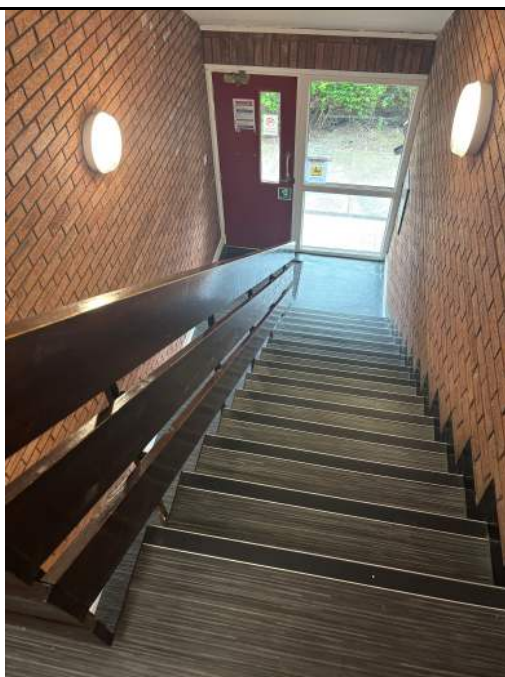


Photo No. 3

Clear MOE



Photo No. 4

Emergency lighting in good condition and secured

Photographs - Fire	
23/04/2026	2 - 5 Elizabeth Terrace



Photo No. 5	Communal fire detection head.
-------------	-------------------------------

6. Risk Calculator - Fire

The following risk estimator is based on the general health and safety risk level estimator contained within BS 8800: 1996. Guide to occupational health and safety management systems.

1. Taking into account the fire prevention measures observed at the time of this risk assessment, it is considered that the hazard from the fire (the probability of ignition) at this building is:

(please insert x below)

LOW ☐ MEDIUM ☒ HIGH ☐

2. Taking into account the nature of the building, the occupants, the fire protection afforded and any procedural arrangements observed at the time of the assessment, it is considered that the consequences for life safety in the event of a fire would be:

(please insert x below)

MINOR ☐ MAJOR ☐ CRITICAL ☒

The definition of the above terms is as follows:

FRA Review Frequency

MINOR	Outbreak of fire is unlikely to result in serious injury or death of any occupant (other than the occupant sleeping in a bedroom in which a fire occurs).
MAJOR	An outbreak of fire could result in injury of one or more occupants, but is unlikely to lead to fatalities.
CRITICAL	There is significant potential for serious injury or death of one or more occupants.

3. The above estimates are then read into the following matrix table to give the overall risk level for the site:

Fire Hazard	Minor	Major	Critical
Low	Trivial	Tolerable	Moderate
Medium	Tolerable	Moderate	Substantial
High	Moderate	Substantial	Intolerable

When the level of risk is established, the action level can be read from the table below:

Risk Level	Guide to actions and appropriate timescales
Trivial	No action is required
Moderate	Efforts should be made to reduce the risk level and this should be carried out within the specified time periods.
Substantial	Considerable resources may have to be allocated to reduce the risk level. It may be necessary to limit the occupation of some parts until urgent remedial action is
Intolerable	The building (or the relevant area) should not be occupied until the risk is reduced.

Action Plan - Fire					
2 - 5 Elizabeth Terrace				23/04/2026	
Enter Risk Rating and Colour Code Here					
Potential area of fire risk	Observation/Comments / Actions Required	Risk Rating	Completion Date	Referred To:	Task ID No.
Fire Hazards					
Electrical Sources of Ignition:					
Electrical Installation within common areas (Fixed Wiring, sockets, switches, light fittings) - any signs of obvious damage		-			
Valid Electrical Installation Condition Reports held on file.(Common Areas)		-			
Valid Electrical Installation Condition Reports held on file. (General Needs Flats)		-			
Electrical App/PA Testing - all portable appliances tested within past 12 months		-			
Absence of trailing leads and adapters		-			
Mobility Scooters - Stored/charged in common areas, purpose built store/resident flat		-			

Smoking:					
Are there any risks associated with smoking in the building?		-			
Arson:					
Adequate security against arson?		-			
Absence of unnecessary fire load in close proximity to building?		-			
Heating Installations					
If portable heaters are used, are there suitable controls?		-			
Are fixed heating installations subject to regular maintenance?		-			
Valid LGSC held on file for each residential flat that contains gas appliances.		-			
Cooking:					
Are reasonable measures taken to prevent fires as a result of cooking?		-			

Where there is extraction ventilation in communal kitchens are filters changed/ cleaned and ductwork cleaned regularly?		-			
Lightning Protection System:					
Does the building have a lightning protection system, If so, is it adequately maintained?		-			
Housekeeping:					
Is the standard of housekeeping adequate?					
Are all electrical/intake/service cupboards secure and free from general waste, contractors waste and residents personal items.					
Are combustible materials separated from ignition sources?		-			
Are unnecessary accumulations of combustible materials or waste avoided?		-			
Are hazardous materials stored appropriately (i.e. oxygen cylinders, flammable materials, explosive products, oxidising products, aerosols)		-			
Furniture/furnishings on escape routes and other communal areas:					
Furniture/furnishings in good condition, fire retardant and complies with 1988 Regulations.		-			

Other Significant Fire Hazards:					
Are there other significant fire hazards that are inadequately controlled?		-			
Fire Protection Measures					
Means of Escape from Fire:					
Is it considered that the building is provided with reasonable means of escape in case of fire?		-			
Escape routes unobstructed and maintained in a sterile condition?		-			
Exits easily and immediately openable where necessary, without a key?		-			
Reasonable distances of travel where there is a single/alternative direction of travel?		-			
Escape routes lead to final exits and open in direction of escape where necessary?		-			
Do failsafe's on locked exit doors function correctly?		-			
Is it considered that the building is provided with reasonable arrangements for means of escape for disabled people?		-			

Measures to Limit Fire Spread and					
Is it considered that the compartmentation is of a reasonable standard?					
Is there reasonable limitation of surface finishes that might promote fire spread (walls, floors, ceilings)?		-			
Are fire dampers/shutters provided in ducts/refuse chutes to protect means of escape against fire, smoke and combustion products?		-			
Compartmentation within roof spaces of a satisfactory standard?		-			
Loft hatches fire resisting?		-			
Fire stopping above cross-corridor fire doors within suspended ceiling void of a satisfactory standard					
Smoke Control Systems (AOV's) Are records of annual testing available?		-			
Roller shutter doors (fire resisting)		-			
Do the external walls, windows, balconies etc pose a risk of significant fire spread?		-			
Communal Area Fire Doors (Inspection to include - construction, closure devices, intumescent/smoke seal condition, glazing systems and maximum gaps between door and frame.					

Fire doors to FD30s standard and in a serviceable condition,					
"Fire door keep shut/locked" signage displayed on both sides of all applicable doors.		-			
Hold open devices operate at the sounding of the alarm and are in a serviceable condition		-			
Flat entrance doors (Internal)					
Do flat entrance doors open onto internal escape routes?		-			
Flats with a single direction of escape to a single escape stairway. (External Balcony)					
Do the flat entrance doors that open onto an external balcony have to be passed during an escape?		-			
Are the separating walls between the flats and the balcony floor that have to be passed during an escape, fire-resisting up to a height of 1.1m?		-			
Emergency Escape Lighting:					
Is the emergency lighting correctly specified and installed as per BS 5266-1:2016		-			

Are all emergency lighting units in good condition and securely fixed to walls/ceilings		-			
Are records of monthly testing available?		-			
Are records of annual testing available?		-			
Fire Safety Signs and Notices:					
Are the correct Fire Action/Advice notices displayed in prominent locations within the common areas?		-			
Directional fire escape signage in place and adequate?		-			
Is there a suitable LIFT sign i.e. do not use in case of fire.		-			
Means of giving Warning in case of Fire:					
Is the fire detection and warning system appropriate for the occupancy and fire risk?					

Is the fire detection and warning system correctly specified and installed as per BS 5839-1:2017	It is recommended that the existing communal fire detection system be removed and that each flat is upgraded to a Grade D, LD2 fire detection system in accordance with BS 5839-6. At present, detection is primarily provided within escape routes, consistent with LD3 principles, with limited additional coverage. While LD3 systems provide a basic level of life protection by alerting occupants once smoke has entered circulation spaces such as hallways and landings, this approach may result in delayed warning. Upgrading to a Grade D, LD2 system will ensure that automatic fire detection is provided not only in escape routes but also within higher-risk rooms such as living rooms and kitchens, where fires are most likely to originate. This will provide earlier warning at the point of fire development, significantly improving life safety. Upgrading to an LD2 system introduces detection in high-risk rooms (e.g. kitchens, living rooms, boiler rooms), significantly improving early fire detection before escape routes become compromised. The removal of the communal detection system is also considered appropriate where a stay-put strategy is in place and effective compartmentation is provided, as communal detection may lead to unnecessary evacuation and is not typically required in purpose-built blocks of flats designed on this basis. This recommendation aligns with the risk-based approach required under the Regulatory Reform (Fire Safety) Order 2005 and reflects current best practice for residential fire safety.	MED	23/07/27	Project manger, fire	2125624
Is the fire detection and warning system maintained/tested and all certificates saved on file. (BS 5839-1:2017)		-			
Are there heat detectors located in the Kitchen, Boiler, Plant Room and Laundry?		-			
Is the fire alarm panel remotely monitored, and if so are there records of regular testing?		-			

Are smoke/heat detectors within General Needs flats subject to an annual inspection and the results recorded on an in date Landlord Gas Safety Record (LGSR)		-			
Fire Extinguishing Equipment:					
Portable fire extinguishers - appropriate type/number/position?		-			
Correct signage displayed by each fire extinguisher?		-			
Fire blanket in communal kitchen, secured to the wall, complete with signage?		-			
Hose Reels - fitted, maintained?		-			
Dry/wet risers - Full access to all inlet/outlet boxes. All inlet/outlets secured and/or securing straps fitted to outlet valves?		-			
Records available of fire fighting equipment servicing within past 12 months		-			
Management of Fire Safety					

Are there suitable arrangements for summoning the fire service?		-			
Do relevant staff carry out regular fire safety checks - SM/HM, BSO/Facilities, HO		-			
Sheltered Schemes & Regional Offices - Are there sufficient number of qualified Fire wardens.		-			
Offices - Are there suitable arrangements for ensuring the premises are evacuated?		-			
Offices - Are there suitable arrangements for evacuating disabled people?		-			
Offices - Are there suitable arrangements for meeting the fire service on arrival and providing relevant information?		-			
Offices/IL Schemes - Is there a suitable assembly point?		-			
Offices - Are fire drills carried out at appropriate intervals?		-			
Evacuation Policy					

Taking the findings of the FRA into account, is the evacuation policy appropriate for the scheme?		-			
Miscellaneous					
Taking the findings of the FRA into account is the frequency of FRA correct?	Following the identification of the need to upgrade the flats fire detection I recommend the frequency and FRA be reviewed once works are completed.	med	26/06/26	Fire Safety Manager	#NAME?

Action Plan - Residents Front Doors						
2 - 5 Elizabeth Terrace				23/04/2026		
Flat No.	Asset No.	Observation/Comments / Actions Required	Risk Rating	Completion Date	Referred To:	Task ID No.
			.			
			.			
			.			
			.			
			.			