



ACCENT HOUSING - FIRE RISK ASSESSMENT



Region :	Yorkshire
Scheme Name :	Astura Court
Scheme Address :	Potternewton Mount Leeds LS7 2DL
Date of Assessment:	19/02/2026
Date of Next Assessment:	19/02/2027
FRA Frequency:	Annual Re-Assessment under the Regulatory Reform (Fire Safety) Order 2005
Fire & Safety Assessor	Steve Manners Tech IOSH MIFSM MFPA DipFD

This Fire Risk Assessment has been conducted upon the instruction of Accent Housing.

Scheme Details		Astura Court
Region:		Yorkshire
Scheme Name:		Astura Court
Site Address:	Street:	Potternewton Mount
	Town:	Leeds
	Post Code:	LS7 2DL
Block & Asset No.		1 - 39 8670
Date of this Assessment		19/02/2026
Date of Next Review		19/02/2027
Fire Risk Assessment Frequency		Annual
Purpose of Fire Risk Assessment		Annual Re-Assessment under the Regulatory Reform (Fire Safety) Order 2005
Fire & Safety Assessor		Steve Manners Tech IOSH MIFSM MFPA DipFD
Director of Customer Experience		Rob Bloom
Housing Partner Manager		Lizzy Robinson
Contract Manager		
Scheme Manager/Customer Partner		Tino Kyriacou
Other staff in attendance		None
Use of Building		Category 2 Independent Living
Approximate Number of occupants		55
Occupancy Profile		Over 55
Familiarity of the occupants		Sleeping Familiar
Likely state of the Occupants		Alert
PEEPs in place where necessary		Peeps carried out and recorded by Scheme Manager (SHP)
Number of on-site Accent staff		Scheme Manager weekdays
Number of other (non-Accent) staff		Contract cleaners in common areas
Support Agency (Supported Housing)		N/A
Current Evacuation Strategy.		Dual system Communal full evacuation flats stay put(Stay Safe)
Evidence that residents have been notified of the evacuation procedure		Fire Evacuation notices displayed in common areas and in place
History of fires in the building		None
Scope of Assessment		Type 1 (Common Parts Only - Non Destructive)
Applicable Fire Safety Guidance		Specialised housing guide

Building Details	Astura Court
Construction Date	1977
Construction Type	Joisted or Load Bearing Masonry (Traditional)
Roof Finish	Pitched-Clay Tile
External Wall Finish	Brick
Are there any areas of external wall cladding	No
Are there any balconies	No
Conversion or purpose-built	Purpose Built
Number of flats (self-contained)/rooms (HMOS, shared houses)	38
Number of storeys above ground Not including Basements	Two
Number of storeys below ground	None
Is there a habitable basement?	No
Number of internal Staircases per Block (protected or unprotected?)	Two-Protected
Number of External Staircases per Block	None
External Balcony part of escape route?	No
Unusual features	None
Building complexity	Simple
Building Access Conditions for Fire Brigade	Vehicular Access to one or more elevations
Surroundings: Residential/Commercial	Residential
Fire Provision Currently in Place	
Fire Detection and Warning System	
Grade of fire alarm (Flats)	Grade D
Category of fire alarm (Flats)	LD3 Minimum Protection
Grade of fire alarm (Communal)	Grade A
Category of fire alarm (Communal)	LD2 Additional Protection
Additional Comments:	
Evacuation Alert System (EAS)	Not Fitted
Additional Comments:	
Emergency Lighting Provision	Non Maintained System Common Areas
Additional Comments:	
Portable Fire Extinguishers	Carbon Dioxide
	Fire Blanket
Additional Comments:	
Fixed Fire Fighting Installations	None fitted
Additional Comments:	

Significant Findings - Fire						
Astura Court				19/02/2026		
Action Ref:	Potential Area of Fire Risk	Yes-No-N/A	Observation/Comments/ Actions Required	Risk Rating	Target Completion Date	Referred To:
Fire Hazards						
1	Electrical Sources of Ignition:					
1.1	Electrical Installation within common areas (Fixed Wiring, sockets, switches, light fittings) in good condition and no obvious damage	Yes	All common area sockets and fittings in a satisfactory condition at the time of inspection	.		
1.2	Valid Electrical Installation Condition Reports held on file.(Common Areas)	Yes	Valid communal area EIC Reports uploaded to property file all In date at time of inspection Last Inspection Date : - 03/10/2022 Satisfactory	.		
1.3	Valid Electrical Installation Condition Reports held on file. (General Needs Flats)	Yes	Valid General Needs flats EIC Reports uploaded to M-Files and ActiveH. Satisfactory	.		
1.4	Electrical App/PA Testing - all portable appliances tested within past 12 months	Yes	Portable devices are PAT Tested, these include Office equipment and electrical equipment within the kitchen.	.		
1.5	Absence of trailing leads and adapters	Yes	None within the communal areas	.		
1.6	Mobility Scooters - Stored/charged in common areas, purpose built store/resident flat	Yes	There is a purpose built scooter store at this scheme. There were no scooters found within the communal areas at the time of inspection. The scooters are subjected to a PAT test annually.	.		
2	Smoking:					

2.1	Are there any risks associated with smoking in the building?	No	Smoking is not allowed within the communal areas. Smoking is only permitted within flats. There are smoking signs present within the communal areas.	.		
3 Arson:						
3.1	Adequate security against arson?	Yes	There is a Fob entry system at the main entrance and all fire exits are operated with a Push bar to open.	.		
3.2	Is there an absence of unnecessary fire load in close proximity to building?	Yes	None found at the time of inspection.	.		
4 Heating Installations (Portable/fixed) Gas Installations - Common Areas & General Needs Residential flats.						
4.1	If portable heaters are used, are there suitable controls?	N/A	There are no portable heaters within the communal area.	.		
4.2	Are fixed heating installations subject to regular maintenance?	Yes	Individual flats have there own gas boilers which are tested annually	.		
4.3	Valid LGSC held on file for each residential flat that contains gas appliances.	Yes	Each individual flat has an annual test certificate which is available on ActiveH and in M-Files. Satisfactory.	.		
5 Cooking:						
5.1	Are reasonable measures taken to prevent fires as a result of cooking?	Yes	Ther is a small kitchen at this scheme which is mainly used for making hot drinks and heating food in a microwave.	.		
5.2	Where there is extraction ventilation in communal kitchens are filters changed/ cleaned and ductwork cleaned regularly?	N/A		.		
6 Lightning Protection System:						
6.1	Does the building have a lightning protection system, If so, is it adequately maintained?	N/A	No lightning conductor system fitted	.		
7 Housekeeping:						
7.1	Is the standard of housekeeping adequate?	Yes	The housekeeping was of a high standard at the time of inspection.	.		

7.2	Are all electrical/intake/service cupboards secure and free from general waste, contractors waste and residents personal items.	Yes		.		
7.3	Are combustible materials separated from ignition sources and stored appropriately?	Yes		.		
7.4	Are unnecessary accumulations of combustible materials or waste avoided?	Yes		.		
7.5	Are hazardous materials stored appropriately (i.e. oxygen cylinders, flammable materials, explosive products, oxidising products, aerosols)	N/A	No evidence of hazardous materials stored on site	.		
8	Furniture/furnishings on escape routes and other communal areas:					
8.1	Furniture/furnishings in good condition, fire retardant and complies with 1988 Regulations.	Yes	All furniture within the communal lounge complies with the latest regulations. No furniture allowed within the other communal areas.	.		
9	Other Significant Fire Hazards:					
9.1	Are there other significant fire hazards that are inadequately controlled?	No		.		
Fire Protection Measures						
10	Means of Escape from Fire:					
10.1	Is it considered that the building is provided with reasonable means of escape in case of fire?	Yes		.		
10.2	Escape routes unobstructed and safe to use?	Other	Some plastic flowers were found in the escape route outside flats 24 and 27. There were wheel chairs found under one of the stairs. Scheme Manager informed at the time of inspection and email sent Items to be removed.	Low	27/2/26	Specialist Housing Partner
10.3	Exits easily and immediately openable where necessary, without a key?	Yes		.		

10.4	Reasonable distances of travel where there is a single/alternative direction of travel?	Yes		.		
10.5	Escape routes lead to final exits and open in direction of escape where necessary?	Yes		.		
10.6	Do failsafe's on locked exit doors function correctly?	Yes		.		
10.7	Is it considered that the building is provided with reasonable arrangements for means of escape for disabled people?	Yes		.		
11	Measures to Limit Fire Spread and Development:					
11.1	Is it considered that the compartmentation is of a reasonable standard?	Yes		.		
11.2	Is there reasonable limitation of surface finishes that might promote fire spread (walls, floors, ceilings)?	Yes		.		
11.3	Are fire dampers/shutters provided in ducts/refuse chutes to protect means of escape against fire, smoke and combustion products?	Yes	Refuse chute doors are fire rated and self-close.	.		
11.4	Compartmentation within roof spaces of a satisfactory standard?	Yes		.		
11.5	Loft hatches fire resisting?	Yes	all Loft hatches are 1 Hour Fire rated	.		
11.6	Fire stopping above cross-corridor fire doors within suspended ceiling void of a satisfactory standard	Yes		.		
11.7	Smoke Control Systems (AOV's) Are records of annual testing available?	N/A	No Automatic vents fitted at this scheme	.		
11.8	Roller shutter doors (fire resisting)	N/A	Not fitted at this scheme.	.		
11.9	Do the external walls, windows, balconies etc pose a risk of significant fire spread?	No		.		
12	Communal Area Fire Doors (Inspection to include - construction, hinges, closure devices, intumescent/smoke seal condition, glazing systems and maximum gaps between door and frame.					

12.1	Communal fire doors to FD30s standard and in a serviceable condition,	No	Communal Fire door opposite flat 11 requires ease and adjust to close to rebate. WO 1355891	Low	31/3/26	Building Safety Project manager
12.2	"Fire door keep shut/locked" signage displayed on both sides of all applicable doors.	Yes		.		
12.3	Hold open devices operate at the sounding of the alarm and are in a serviceable condition	Yes	These are tested weekly with the fire alarm, tested at the time of inspection. Satisfactory.	.		
13	Flat entrance doors (Internal Common Areas)					
13.1	Do flat entrance doors open onto internal escape routes?	Yes		.		
14	Flats with a single direction of escape to a single escape stairway. (External Balcony)					
14.1	Do the flat entrance doors that open onto an external balcony have to be passed during an escape?	N/A		.		
14.2	Are the separating walls between the flats and the balcony floor that have to be passed during an escape, fire-resisting up to a height of 1.1m?	N/A		.		
15	Emergency Escape Lighting:					
15.1	Is the emergency lighting correctly specified and installed as per BS 5266-1:2016	Yes		.		
15.2	Are all emergency lighting units in good condition and securely fixed to walls/ceilings	Yes	All in good condition at the time of inspection.	.		
15.9	Are records of monthly testing available?	Yes	Monthly test certs uploaded to M-Files and ActiveH In date at time of inspection. Last test date : - 19/01/2026	.		
15.10	Are records of annual testing available?	Yes	Annual test certs uploaded to M-Files and ActiveH In date at time of inspection. Last test date : - 04/06/2025	.		
16	Fire Safety Signs and Notices:					

16.1	Are the correct Fire Action/Advice notices displayed in prominent locations within the common areas?	Yes	The correct Notices are displayed throughout the scheme.	.		
16.3	Directional fire escape signage in place and adequate?	Yes		.		
16.4	Is there a suitable LIFT sign i.e. do not use in case of fire.	N/A	No lift present at this scheme.	.		
17	Means of giving Warning in case of Fire:					
17.1	Is the fire detection and warning system appropriate for the occupancy and fire risk?	Yes	There is a dual Fire alarm system within the scheme. The communal areas are protected with smoke and heat detection, this includes storage cupboards and electrical rooms. The flats have detection which is monitored by a warden call system.	.		
17.2	Is the fire detection and warning system correctly specified and installed as per BS 5839-1:2017	Yes		.		
17.3	Is the fire detection and warning system maintained/tested and all certificates saved on file. (BS 5839-1:2017)	Yes		.		
17.4	Are there heat detectors located in the Kitchen, Boiler, Plant Room and Laundry?	Yes		.		
17.5	Is the fire alarm panel remotely monitored, and if so are there records of regular testing?	Yes	Testing is carried out weekly by the Scheme Manager (SHP) and the 6 Monthly test is carried out by our contractors Tunstall Last test date weekly : - 19/02/2026 Last test date 6 Monthly : - 16/12/2025	.		
17.6	Are smoke/heat detectors within General Needs flats subject to an annual inspection and the results recorded on an in date Landlord Gas Safety Record (LGSR)	Yes	All detection is carried out Annually in conjunction with the (LGSR)	.		
18	Fire Extinguishing Equipment:					

18.1	Portable fire extinguishers - appropriate type/number/position?	Yes	Only provided in the high risk areas of the scheme.	.		
18.2	Correct signage displayed by each fire extinguisher?	Yes		.		
18.3	Fire blanket in communal kitchen, secured to the wall, complete with signage?	Yes		.		
18.4	Hose Reels - fitted, maintained?	N/A		.		
18.5	Dry/wet risers - Full access to all inlet/outlet boxes. All inlet/outlets secured and/or securing straps fitted to outlet valves?	N/A		.		
18.6	Records available of fire fighting equipment servicing within past 12 months	Yes	Certificates can be found in ActiveH and M-Files. Test dates are available on the extinguisher labels.	.		
19	Management of Fire Safety					
19.1	Are there suitable arrangements for summoning the fire service?	Yes	The fire alarm systems are monitored, Residents are also advised to dial 999 and ask for the Fire Service.	.		
19.2	Do relevant staff carry out regular fire safety checks	Yes	Housing Partners do scheme inspections.	.		
19.3	Sheltered Schemes & Regional Offices - Are there sufficient number of qualified Fire wardens.	N/A		.		
19.4	Offices - Are there suitable arrangements for ensuring the premises are evacuated?	N/A		.		
19.5	Offices - Are there suitable arrangements for evacuating disabled people?	N/A		.		
19.6	Offices - Are there suitable arrangements for meeting the fire service on arrival and providing relevant information?	N/A		.		
19.7	Offices/IL Schemes - Is there a suitable assembly point?	Yes	In the car Park to the front of the building.	.		
19.8	Offices - Are fire drills carried out at appropriate intervals?	N/A		.		

20	Evacuation Policy				
20.1	Taking the findings of the FRA into account, is the evacuation policy appropriate for the scheme?	Yes	The evacuation policy is correct for this type of building. The flats were Purpose built to allow residents to stay safely within there flats.	.	
21	Miscellaneous				

Photographs - Fire

19/02/2026

Astura Court



Photo No. 1

Wheelchair and walking aids under the stairs.

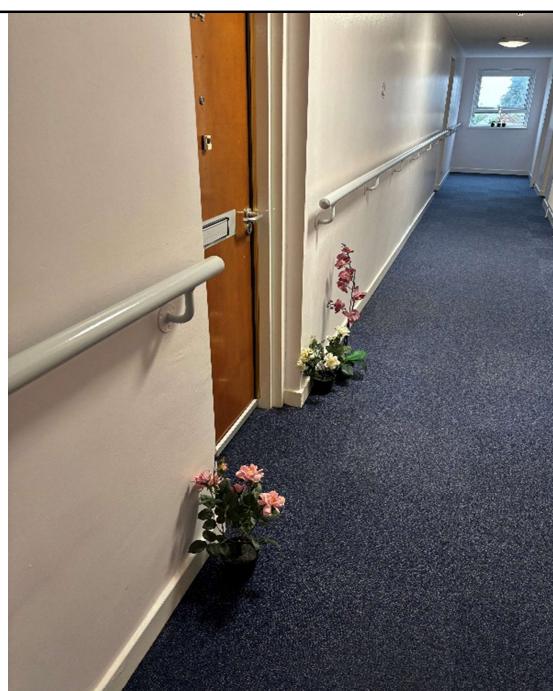


Photo No. 2

Picture on wall and plastic flowers on escape route.

Photographs - Fire

19/02/2026

Astura Court



Photo No. 3

Fire Panel and Zone plan.



Photo No. 4

Fire Notice.

Photographs - Fire

19/02/2026

Astura Court



Photo No. 5

Pat test cert.



Photo No. 6

Scooter store

Photographs - Fire

19/02/2026

Astura Court



Photo No. 7

1 Hour rated Loft Hatch.



Photo No. 8

Directional escape and no Smoking signage throughout the Scheme

Photographs - Fire

19/02/2026

Astura Court

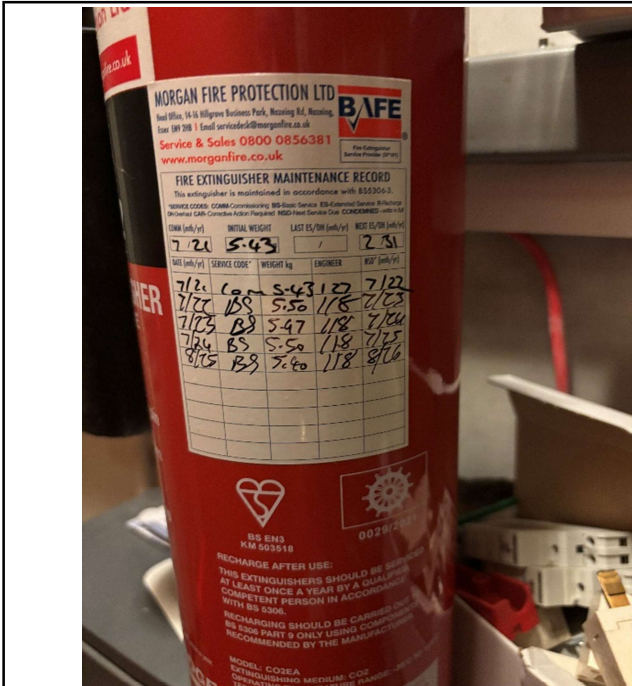


Photo No. 9

Extinguisher and Fire Blanket, in date.

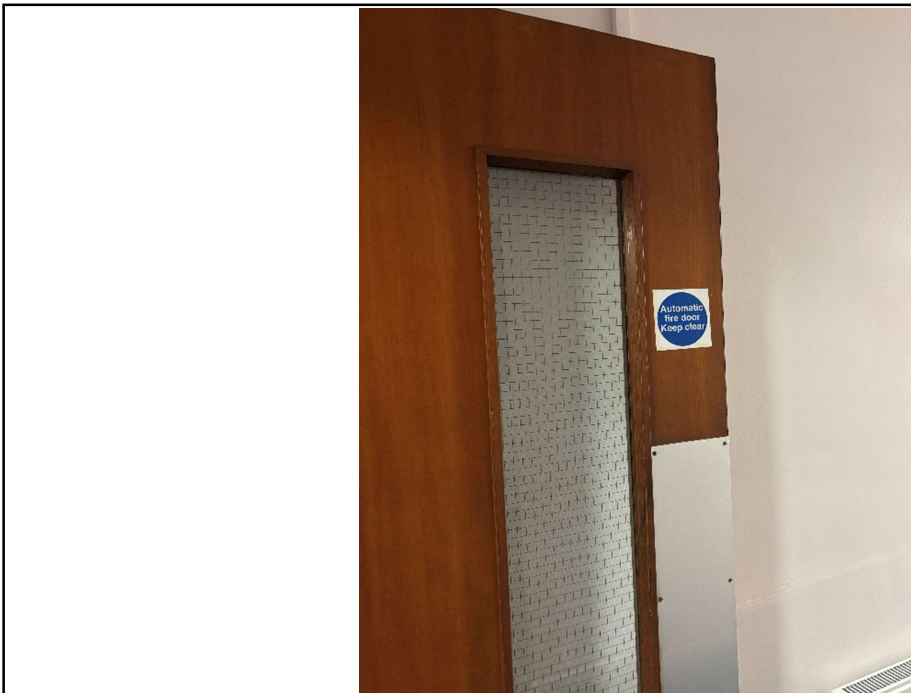


Photo No. 10

Cross Corridor signage.

Photographs - Fire	
19/02/2026	Astura Court

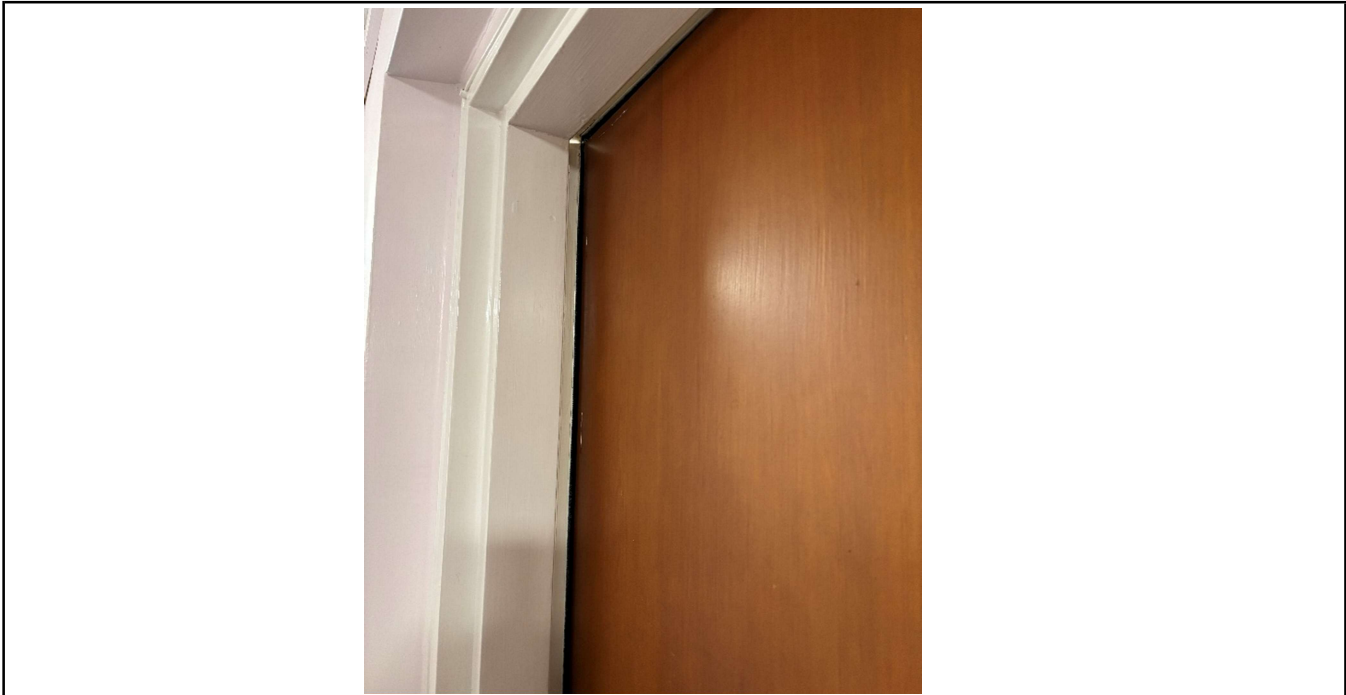


Photo No. 11	Communal Fire door opposite flat 11 requires ease and adjust to close to rebate.
--------------	--

6. Risk Calculator - Fire

The following risk estimator is based on the general health and safety risk level estimator contained within BS 8800: 1996. Guide to occupational health and safety management systems.

1. Taking into account the fire prevention measures observed at the time of this risk assessment, it is considered that the hazard from the fire (the probability of ignition) at this building is:

(please insert x below)

LOW ☒ MEDIUM ☐ HIGH ☐

2. Taking into account the nature of the building, the occupants, the fire protection afforded and any procedural arrangements observed at the time of the assessment, it is considered that the consequences for life safety in the event of a fire would be:

(please insert x below)

MINOR ☐ MAJOR ☒ CRITICAL ☐

The definition of the above terms is as follows:

FRA Review Frequency

MINOR	Outbreak of fire is unlikely to result in serious injury or death of any occupant (other than the occupant sleeping in a bedroom in which a fire occurs).
MAJOR	An outbreak of fire could result in injury of one or more occupants, but is unlikely to lead to fatalities.
CRITICAL	There is significant potential for serious injury or death of one or more occupants.

3. The above estimates are then read into the following matrix table to give the overall risk level for the site:

Fire Hazard	Minor	Major	Critical
Low	Trivial	Tolerable	Moderate
Medium	Tolerable	Moderate	Substantial
High	Moderate	Substantial	Intolerable

When the level of risk is established, the action level can be read from the table below:

Risk Level	Guide to actions and appropriate timescales
Trivial	No action is required
Moderate	Efforts should be made to reduce the risk level and this should be carried out within the specified time periods.
Substantial	Considerable resources may have to be allocated to reduce the risk level. It may be necessary to limit the occupation of some parts until urgent remedial action is
Intolerable	The building (or the relevant area) should not be occupied until the risk is reduced.

Action Plan - Fire					
Astura Court				19/02/2026	
Enter Risk Rating and Colour Code Here					
Potential area of fire risk	Observation/Comments / Actions Required	Risk Rating	Completion Date	Referred To:	Task ID No.
Fire Hazards					
Means of Escape from Fire:					
Escape routes unobstructed and maintained in a sterile condition?	Some plastic flowers were found in the escape route outside flats 24 and 27. There were wheel chairs found under one of the stairs. Scheme Manager informed at the time of inspection and email sent Items to be removed.	Low	27/02/26	Specialist Housing Partner	
Communal Area Fire Doors (Inspection to include - construction, closure devices, intumescent/smoke seal condition, glazing systems and maximum gaps between door and frame.					
Fire doors to FD30s standard and in a serviceable condition,	Communal Fire door opposite flat 11 requires ease and adjust to close to rebate. WO 1355891	Low	31/03/26	Building Safety Project manager	